


ELEVATION
NTS

NOTE:
THIS DETAIL APPLIES
TO ALL PROJECTS
APPROVED AFTER
MAY 5, 2008

- Notes:
1. Until the hydrant is ready for service and accepted by the County, the Contractor shall bag the hydrant with a polypropylene bag marked "not in service".
 2. All paint damaged during installation shall be repaired prior to final acceptance.

REVISIONS:	CALVERT COUNTY DEPARTMENT OF PUBLIC WORKS-BUREAU OF UTILITIES	STANDARD DETAILS	W 1.06
5-7-08			
	APPROVED: 	FIRE HYDRANT ASSEMBLY	Sheet 1 of 2
	DATE: MAY 1, 2008		

NOTE:
RESTRAIN ALL JOINTS

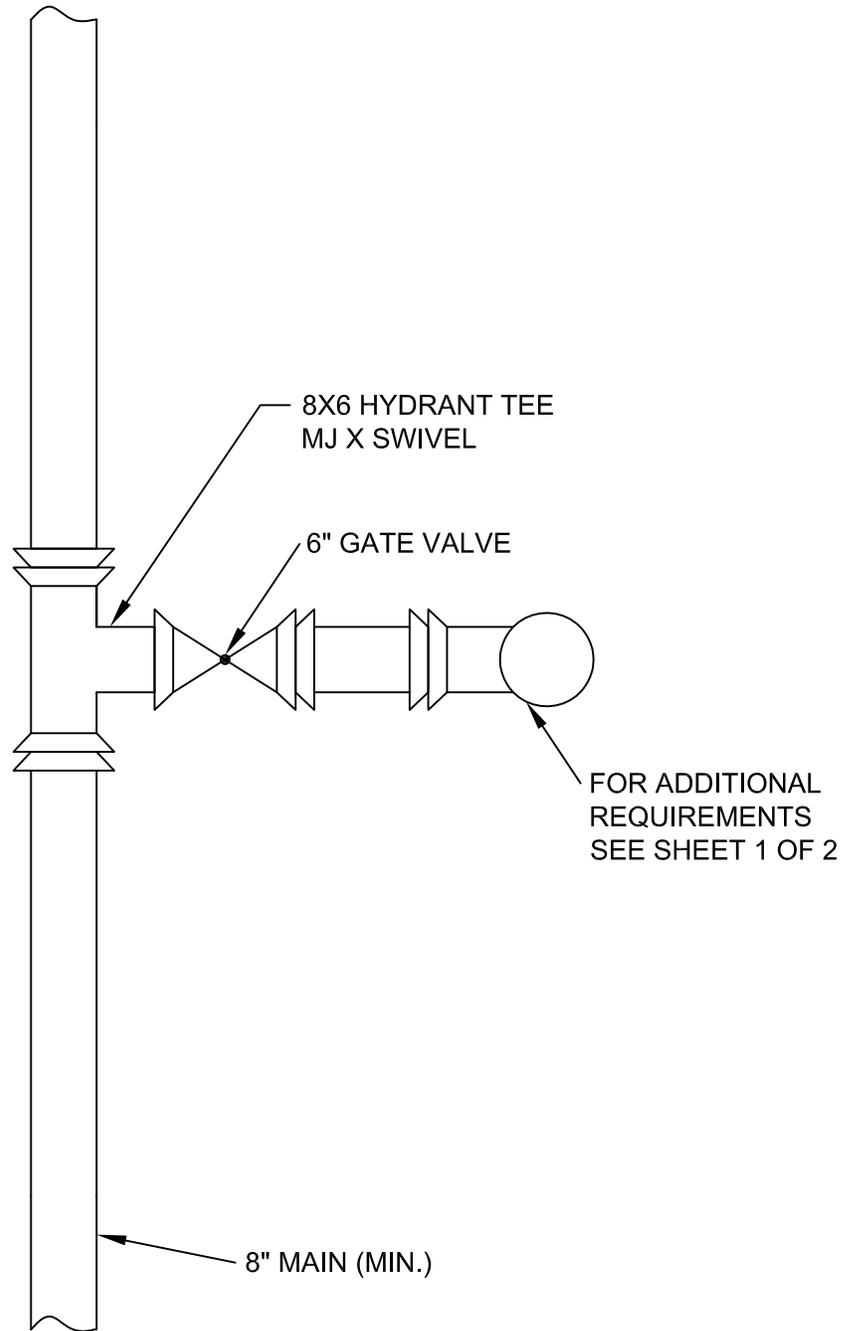

PLAN
NTS

NOTE:
THIS DETAIL APPLIES
TO ALL PROJECTS
APPROVED AFTER
AUGUST 22, 2013

REVISIONS:	CALVERT COUNTY DEPARTMENT OF PUBLIC WORKS—BUREAU OF UTILITIES APPROVED: <u><i>D. G. Taylor</i></u> BUREAU CHIEF DATE: <u>AUGUST 22, 2013</u>	STANDARD DETAILS	<u>W</u> 1.06 Sheet 2 of 2
5-7-08		FIRE HYDRANT ASSEMBLY	
8-22-13			