


NOTE:
IF NO FUTURE
CONNECTION POSSIBLE
NOR PLANNED,
ELIMINATE 8" VALVE AT
END OF LINE

NOTE:
RESTRAIN ALL JOINTS

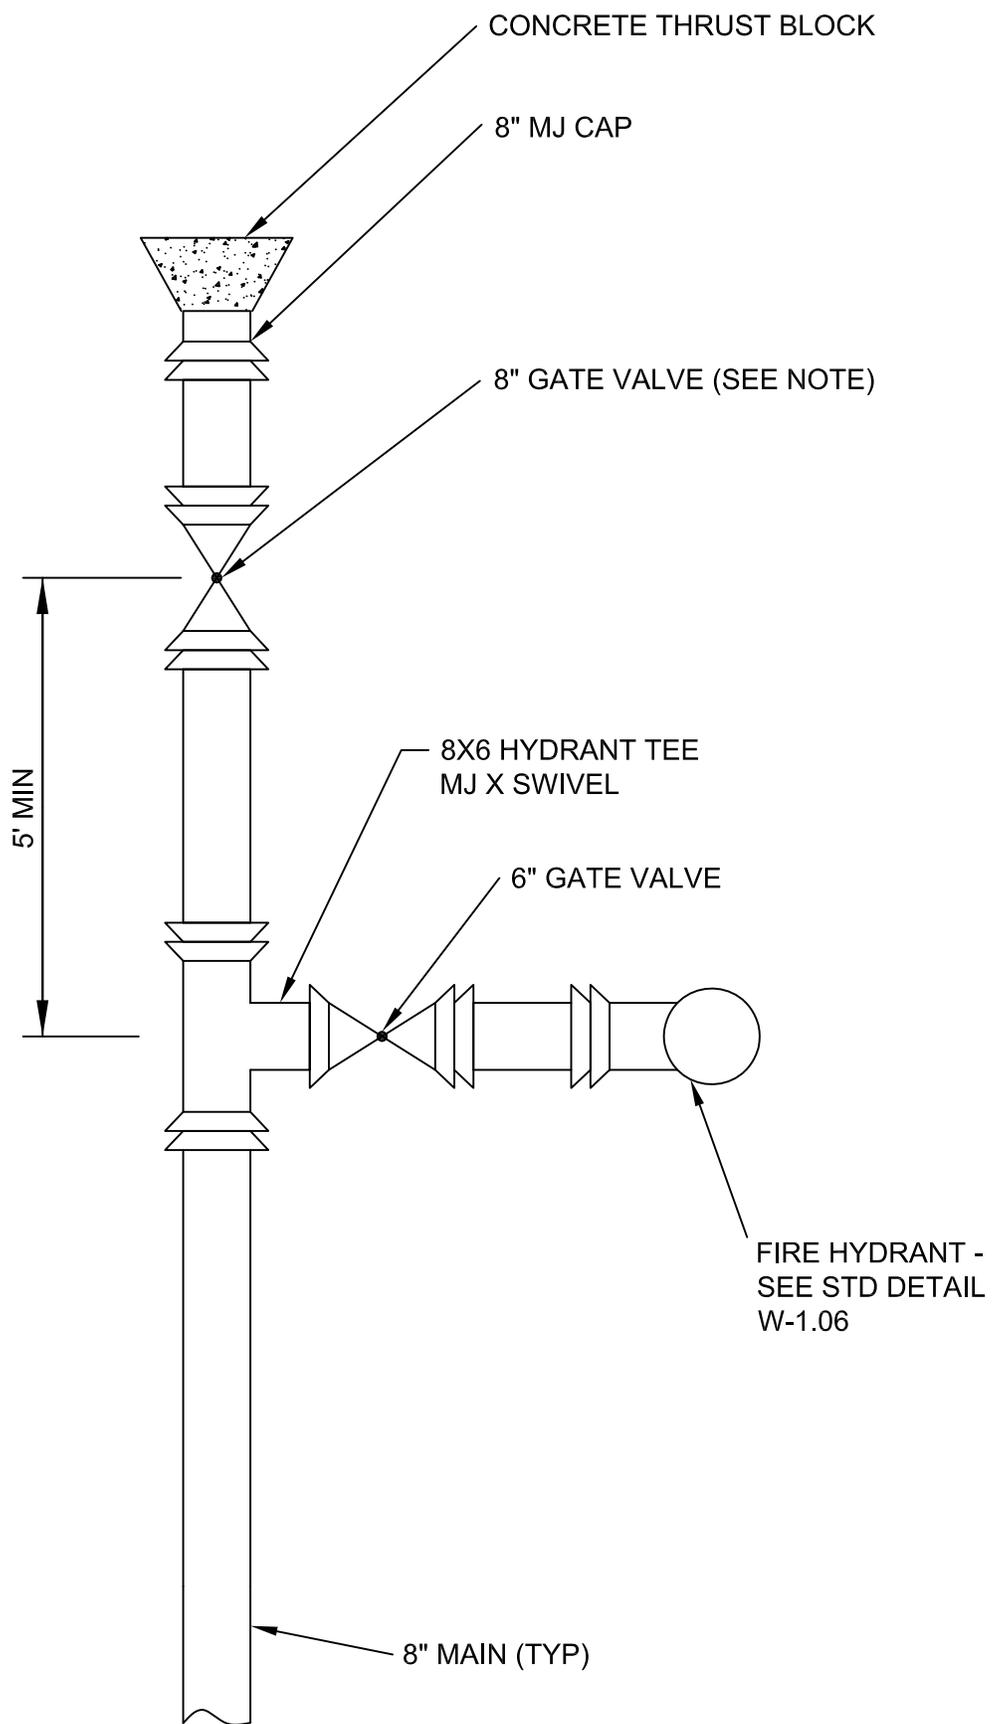

NOTE:
THIS DETAIL APPLIES
TO ALL PROJECTS
APPROVED AFTER
AUGUST 23, 3013

REVISIONS:	CALVERT COUNTY DEPARTMENT OF PUBLIC WORKS—BUREAU OF UTILITIES	STANDARD DETAILS	W 1.28
8-23-13			
	APPROVED: <u><i>R. G. Wolfe</i></u> BUREAU CHIEF	FIRE HYDRANT AT END OF LINE FOR FUTURE CONNECTION	
	DATE: <u>AUGUST 23, 2013</u>		