


ELEVATION
SCALE: 1/2"=1'- 0"

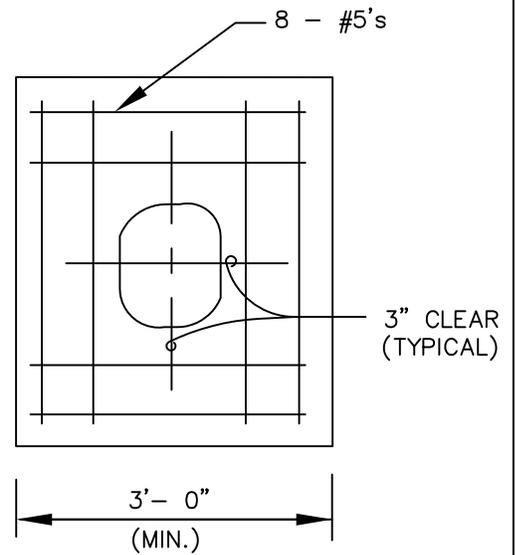

SECTION A-A
SCALE: 1/2"=1'- 0"

NOTES:

1. FOR 4", 6", 8", 10", & 12" DUCTILE IRON AND PVC PIPES
2. $f_c = 3000$ PSI @ 28 DAYS.
3. ALL REINFORCING STEEL TO BE ASTM A-615 GRADE 60.
4. CARRY ALL BEARING SURFACES TO FIRM SUBGRADE. PLACE CONCRETE ANCHOR AGAINST DOWNGRADE SIDE OF BELL.
5. UTILIZE A LAYER OF ROOFING PAPER BETWEEN PIPE AND CONCRETE.

REVISIONS:	CALVERT COUNTY		STANDARD DETAILS	$\frac{W}{1.34}$
	DEPARTMENT OF PUBLIC WORKS-BUREAU OF UTILITIES			
	APPROVED:	 BUREAU CHIEF		
DATE:	DECEMBER 15, 2004			