


NOTE

IF WATERLINE IS LESS THAN 4", USE 2" TEE.  
IF 4" OR LARGER, USE DOUBLE STRAP SS SADDLE.

PLAN

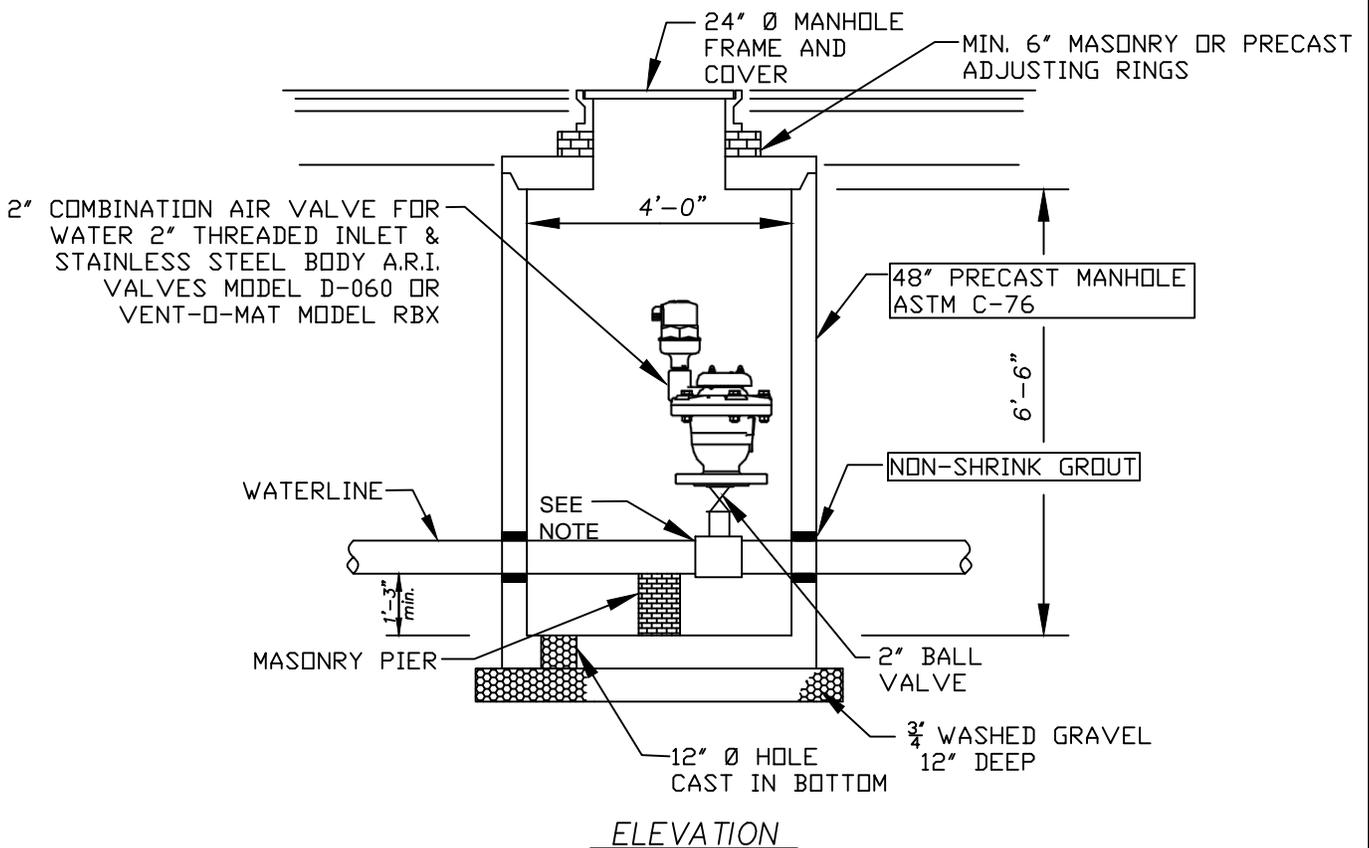

ELEVATION

WATER COMBINATION  
AIR VALVE

NO SCALE

REVISIONS:	CALVERT COUNTY		STANDARD DETAILS	W 1.50
	DEPARTMENT OF PUBLIC WORKS—BUREAU OF UTILITIES			
	APPROVED:	<i>R. Ly. Hart</i> BUREAU CHIEF		
	DATE:	AUGUST 26, 2013		