



**DETAIL A**

NTS

**TOP VIEW**

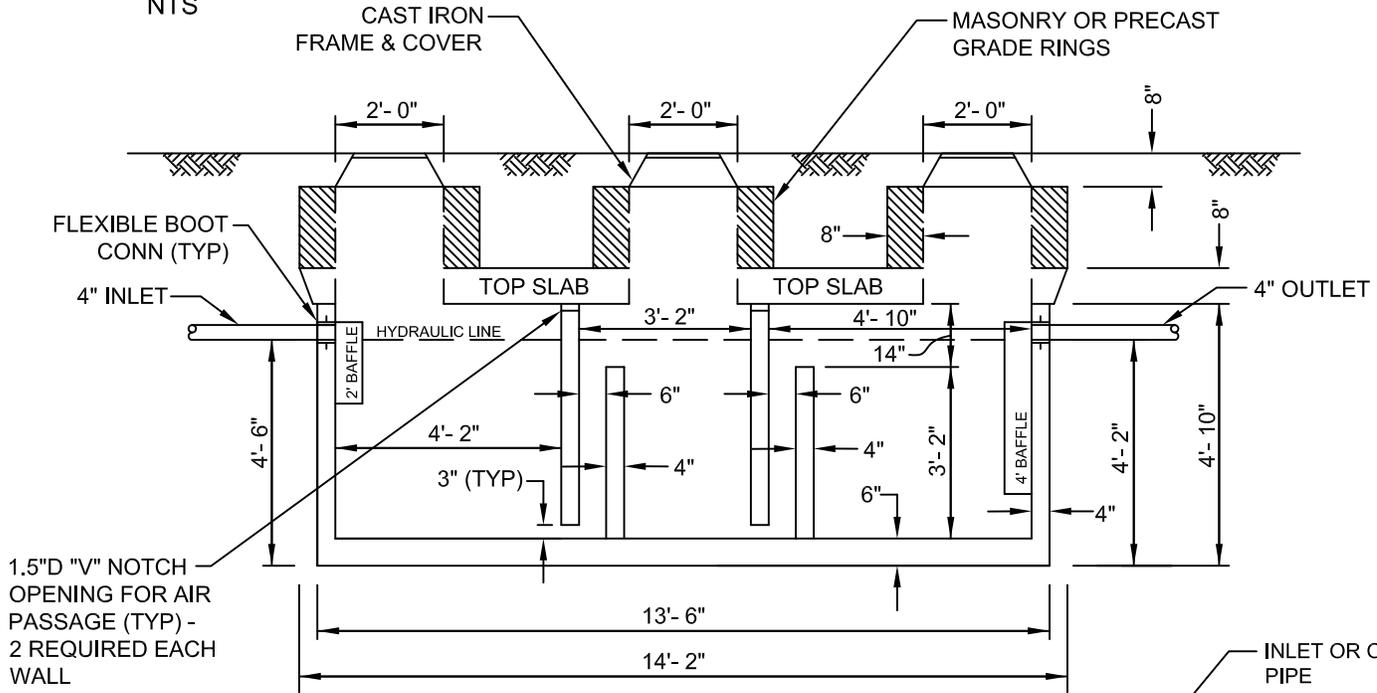

**SECTION VIEW**

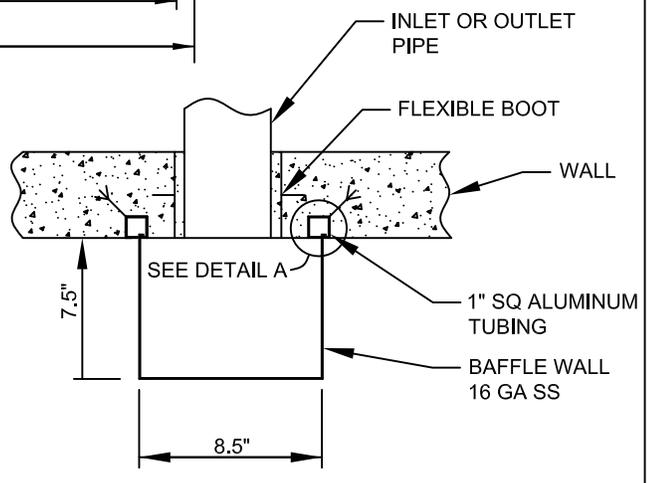

**BAFFLE DETAIL**

NTS

**NOTES:**

- (1) TANK VOLUME: 1600 GAL. MIN.; IF OVER 50 SEATS, 2000 GAL. VOLUME SHALL BE PROVIDED BELOW THE HYDRAULIC LINE
- (2) THE COUNTY CAN DIRECT TO UPSIZE OR DOWNSIZE THE CAPACITY OF A GREASE TRAP BASED ON REVIEW OF MENU ITEMS, TYPE OF OPERATION AND OTHER FACTORS.
- (3) THE PRECAST STRUCTURE SHALL CONFORM TO THE REQUIREMENTS OF AASHTO M199. CONCRETE SHALL BE MINIMUM 5,000 PSI. TANK AND ALL COMPONENTS SHALL BE DESIGNED FOR H-20 HIGHWAY LOADING. BY REGISTERED MARYLAND PROFESSIONAL ENGINEER.
- (4) FRAMES, COVERS, AND TOP SLABS SHALL BE TRAFFIC BEARING WHEN INTERCEPTOR IS LOCATED IN TRAVEL AREAS.
- (5) FRAMES AND COVERS SHALL BE HEAVY DUTY AND COVERS TO BE MARKED "GREASE".

REVISIONS:	<p><b>CALVERT COUNTY</b></p> <p>DEPARTMENT OF PUBLIC WORKS—BUREAU OF UTILITIES</p> <p>APPROVED: _____</p> <p style="text-align: center;">BUREAU CHIEF</p> <p>DATE: _____</p> <p style="text-align: center;">MAY 16, 2008</p>	<p>STANDARD DETAILS</p> <p>1600 GAL. OUTSIDE GREASE INTERCEPTOR</p>	<p>S</p> <p>1.18</p>
------------	--	---	----------------------