
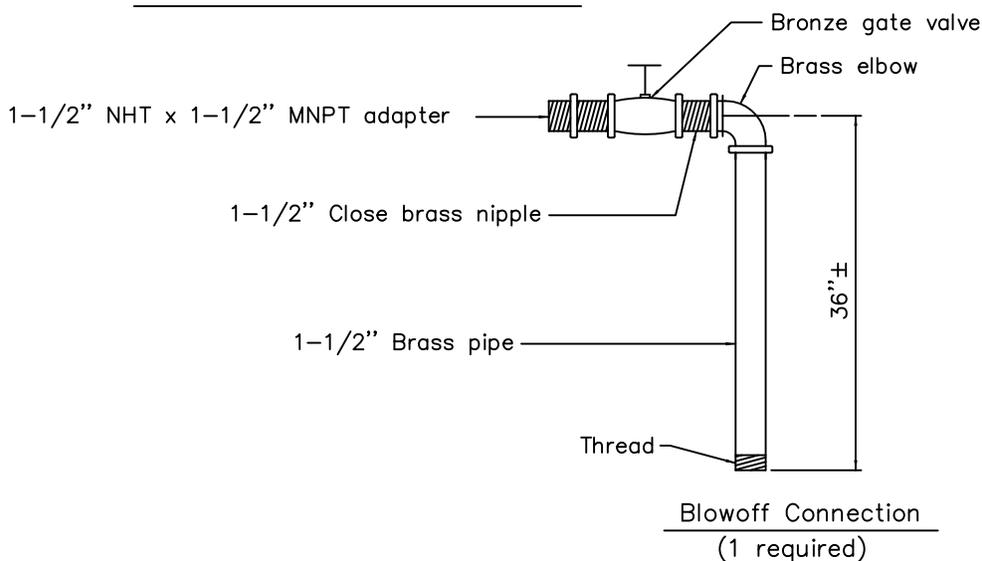


Notes

1. Brass pipe shall be standard dimension "extra strong" conforming to ASTM B-43.
2. Brass screw fittings shall be 125 lb. cast bronze or brass conforming to ASA B-16.15.

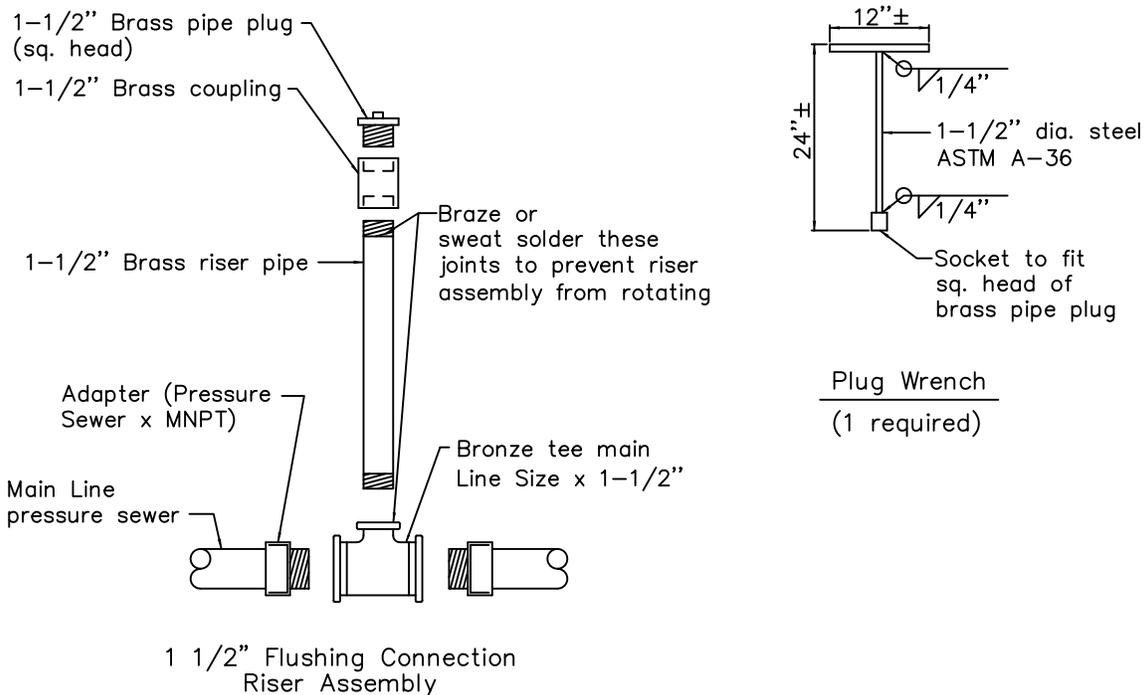

Note:

This detail applies to all projects approved after May 5, 2008

REVISIONS:	CALVERT COUNTY DEPARTMENT OF PUBLIC WORKS—BUREAU OF UTILITIES APPROVED:  BUREAU CHIEF DATE: DECEMBER 15, 2004	STANDARD DETAILS	$\frac{S}{1.33}$
5-1-08		FITTINGS FOR FLUSHING CONN.	
		RISER ASSEMBLY	