


NOTE

IF FORCE MAIN LESS THAN 4", USE 2" TEE.
IF 4" OR LARGER, USE DOUBLE STRAP SS SADDLE.

PLAN

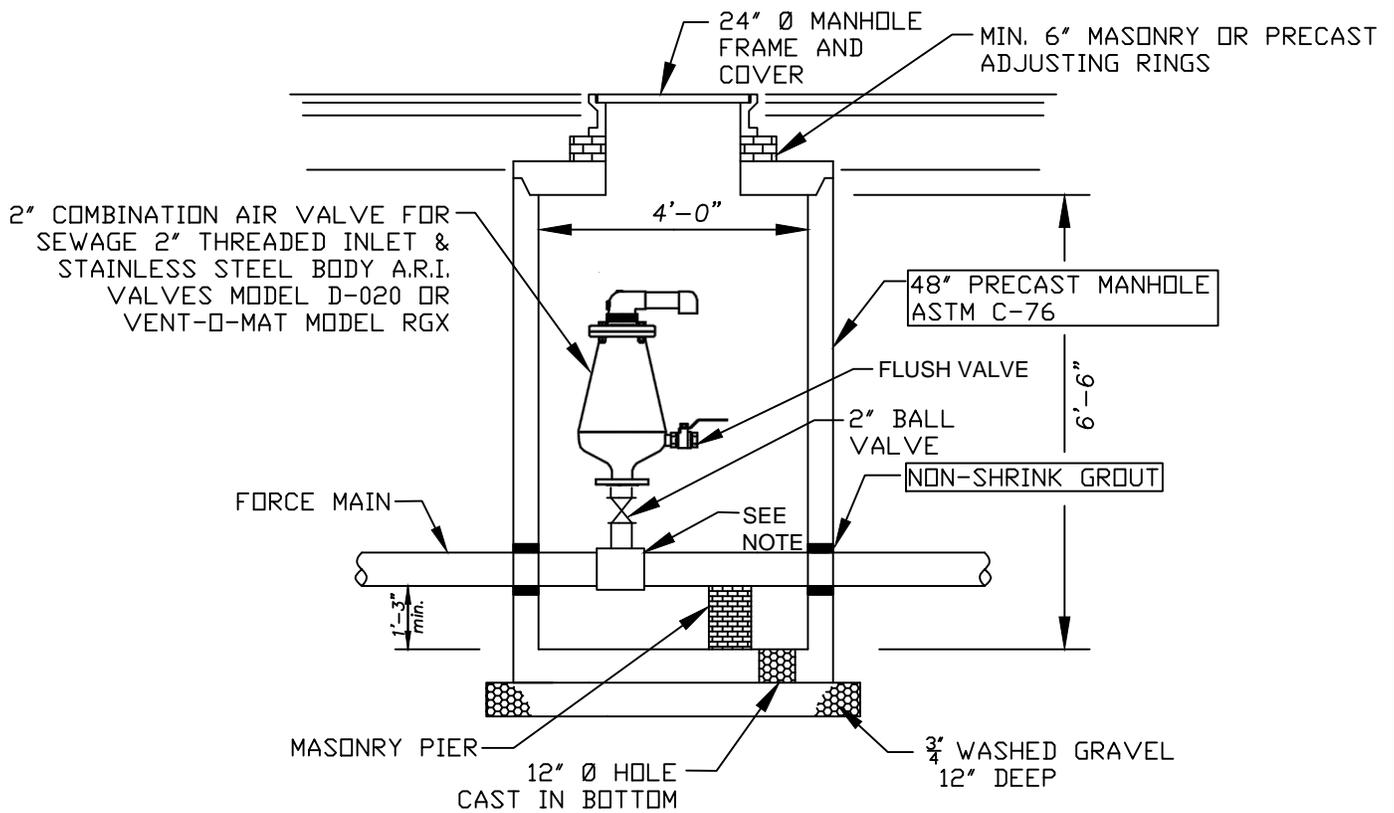

ELEVATION

SEWAGE AIR COMBINATION VALVE

NO SCALE

| | | | |
|-----------------|--|-----------------------------|-------------------------|
| REVISIONS: | CALVERT COUNTY | STANDARD DETAILS | S 1.50 |
| REVISED 3/15/05 | DEPARTMENT OF PUBLIC WORKS—BUREAU OF UTILITIES | SEWAGE AIR RELEASE VALVE | |
| REVISED 8/23/13 | APPROVED: BUREAU CHIEF | | |
| | DATE: AUGUST 23, 2013 | | |